

Improvement in Power Quality of Matrix Converter Interfaced Wind Turbine Emulator

Naveen Sen, Prof. S.N.A. Jaaffery

Abstract— We have seen that the nominal power of single Wind Energy Converter Systems has been steadily growing up and reaching power ratings close to 10 MW. In the power conversion stage, we found that the medium-voltage power converters are replacing the conventional low-voltage back-to-back topology. Due to this reason the Matrix Converters interfaced have appeared as a promising solution for Multi-MW WECSs due to their characteristics such as modularity, reliability and the capability to reach high nominal voltages. In 2009-10, the country imported 159.26 million tons of crude oil which amounts to 80% of its domestic crude oil consumption and 31% of the country's total imports are oil imports. The growth of electricity generation in India has been hindered by domestic coal shortages and as a consequence, India's coal imports for electricity generation increased by 18% in 2010. So in this paper I try to develop fuzzy-logic based control strategy to capture maximum wind energy and reduce harmonics for proposed wind generation system and then develops fuzzy control for indirect matrix converter under steady-state and dynamic conditions. With these assumptions finally try to validate the proposed wind generation system in simulation environment to validate the developed control algorithms under various balanced /unbalanced conditions. Finally evaluate the performance of the developed wind generation system and its controls under various balanced/unbalanced wind conditions. During investigating details the robustness of the steady-state and dynamic performance of the developed system under various balanced/unbalanced conditions using simulation software I presents the experimental performance evaluation of the developed matrix converter prototype with wind emulator.

Index Terms— Wind energy conversion system (WECS), Matrix converter, Wind emulator, space vector pulse width modulation (SVPWM), permanent magnet synchronous generators (PMSGs), wind farms (WFs).

I. INTRODUCTION

Wind power is one of the most promising sources of renewable energy, and the application of wind turbines is one of the cheapest alternatives to reduce CO₂ emissions from electrical power production. This paper addresses the mentioned problem and demonstrates how the power quality may be improved by using of matrix converter interfaced wind turbine emulator. The turbines are up-wind, horizontal-axis, stall-regulated machines. [1] Each turbine drives a dual-power, two-speed, asynchronous induction generator with an output of 150 kW at wind speeds of up to 7.8 m/s. In the wind farm, each wind turbine generator is equipped with a 0.69/15 kV step-up transformer. All transformers are connected to the

Local 15 kV network cable which consists of five radial feeders, of which two are connected to nine generators each. [2]

The wind energy conversion system consists of a horizontal-axis WT, a three phase PMSG and indirect matrix converter (IMC). The extracted power from wind is directly transmitted to the generator and is converted into electrical power. The generated power then fed to the utility grid through IMC.

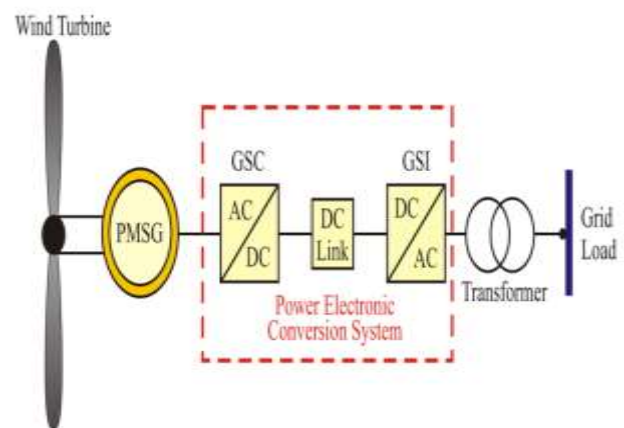


Figure 1: Graphic figure of a direct-drive PMSG-based WECS linked to a grating.

IMC is used for interfacing with the grid, and SVPWM control is effectively used to achieve low harmonic characteristics.

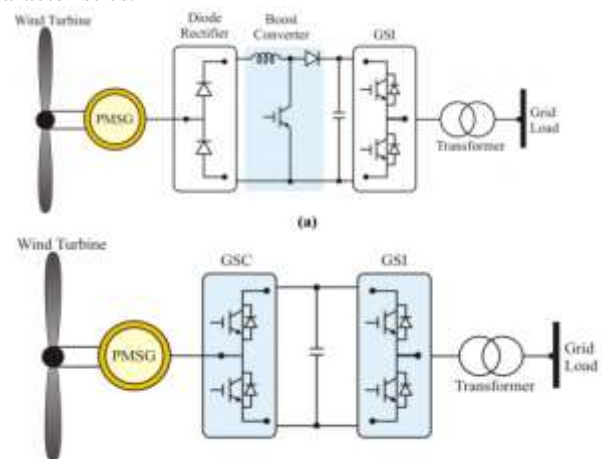


Figure 2: PMSG-based WECS (A direct-drive) with (a) GSC containing of a diode rectifier and an improvement device that transforms, (b) 2-level AC/DC/AC PWM transformer system.

Wind Turbine Model:

A dynamic mathematical model of various components of the proposed wind generation system like indirect matrix converter, PMSG, and the adaptive fuzzy logic control system incorporating the perturbation and observation type MPPT to be used for controller design purposes. [3]

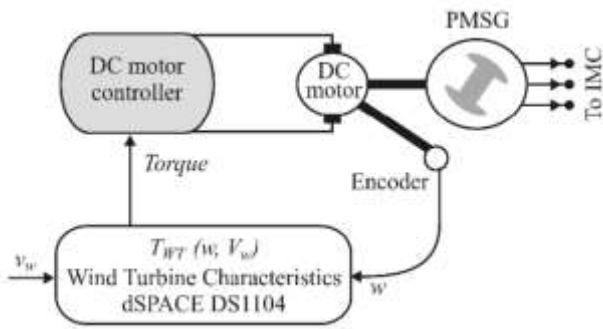


Figure 3: Wind emulate system

Indirect matrix converter which finds its suitable application for generation system is used to interface the PMSG by:

$$T_m = \frac{1}{2} \pi \rho C_p(\lambda) R^3 \omega V_w^2$$

$$P_o = \frac{1}{2} \rho C_p A_r V_w^3$$

The power factor at the interface with the grid is also controlled by the indirect matrix converter to either ensure purely active power injection into the grid for optimal utilization of the wind generation system, and also assists in regulation of voltage and frequency at the grid.[4]

Active Exemplary of Indirect Voltage-Amplified by matrix converter:

Since input terminal a, b and c are connected to voltage sources, they must not be short circuited through the IMC switches. Similarly, as output terminals A, B and C are connected to current sources, they must not be open-circuited at any instant. Based on these constraints, the switching function for each switch is:

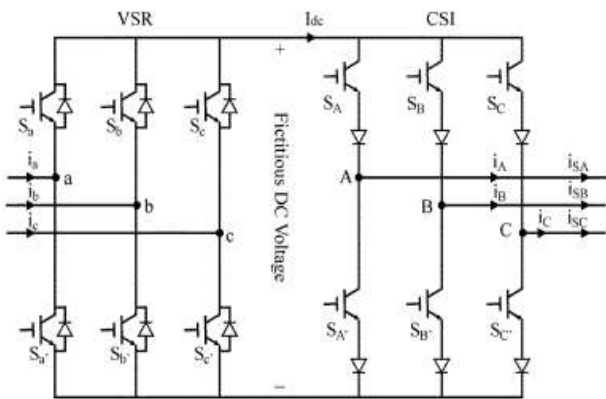


Figure 4: Block diagram of the Indirect Voltage-Amplified by matrix converter

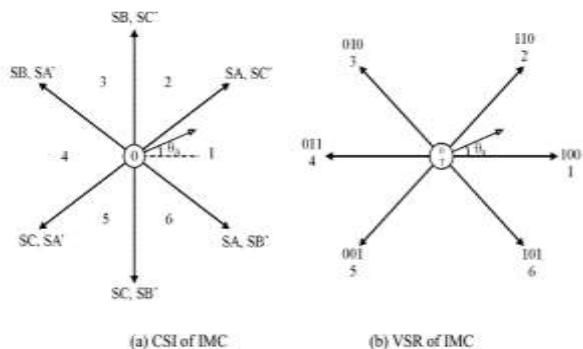


Figure 5: Space vector representation for CSI and VSR of IMC

II. PROPOSED PERTURBATION & OBSERVATION TYPE MPPT

The SVPWM switching of IMC also helps in keeping the total harmonic distortion (THD) in load voltages to 2.6% for phase A, 3.2% for phase B, and 3.0 %, for phase C, which is below the acceptable limit of 5% as per IEEE-519 standards. The procedure can be illuminated as below:

$$\text{Perturbation : } \omega_{ref}(t) = \omega_{ref}(t-1) + s|\Delta\omega_{ref}|$$

$$\text{Observation : } \Delta P_0 = P_0(t) - P_0(t-1)$$

A robust sliding mode controller has been used by the indirect matrix converter to track accurately and precisely the optimum angular frequency by regulating the switching frequency of the IMC. [5] The controller is designed on the basis of double integral state variables and state feedback law. This controller has been chosen due to better dynamic performance over wide range as compared to conventional controls; more immune to effects of external disturbances and parameter variations; and more robust under load variations. [6]

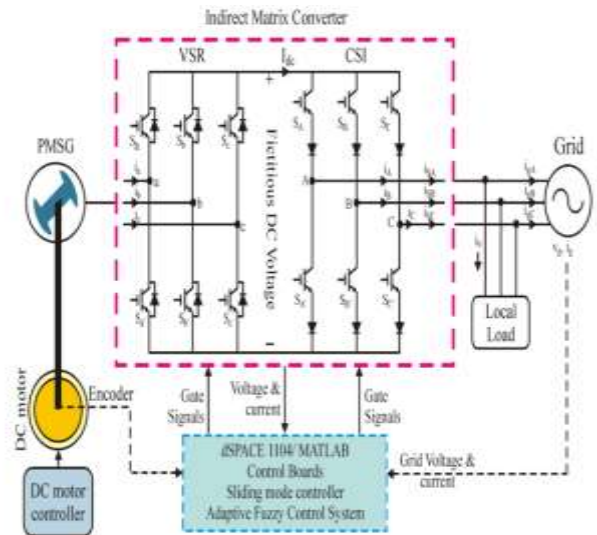


Figure 6: Overall Box Figure of the indirect matrix converter interfaced PMSG for wind energy conversion system

III. SIMULATION RESULTS AND DISCUSSION

The National Institute for Wind Energy's (NIWE) latest estimate for India's wind power potential is 302 GW at 100 meters. The major wind power states are Tamil Nadu, Gujarat, Karnataka, Maharashtra and Rajasthan. The present study is conducted to compare the financial performance of dSPACE on the basis of ratios such as credit deposit, net profit margin etc. [7] The study found that dSPACE is performing well and implemented using dSPACE DS1104 real time board. Considering the renewable energy potential in India, a rapid push is needed to meet this goal. About 70% of India's energy generation capacity is from fossil fuels, with coal accounting for 40% of India's total

energy consumption followed by crude oil and natural gas at 24% and 6% respectively.

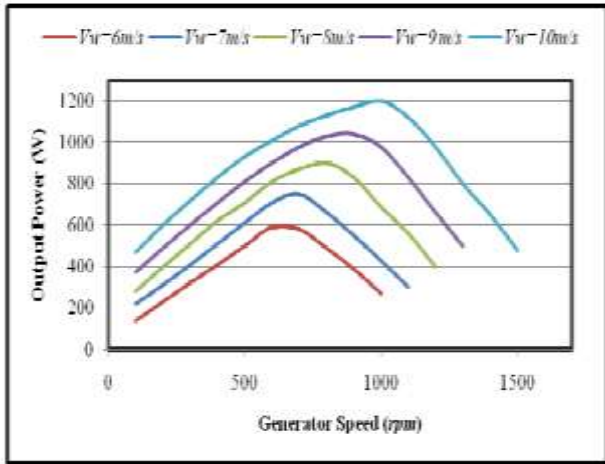


Figure 7: Experimental plot of generator speed versus output power for different wind speeds.

3.1 Response during Steady-State Condition

The growth of electricity generation in India has been hindered by domestic coal shortages and as a consequence, India's coal imports for electricity generation increased by 18% and 519 standards.


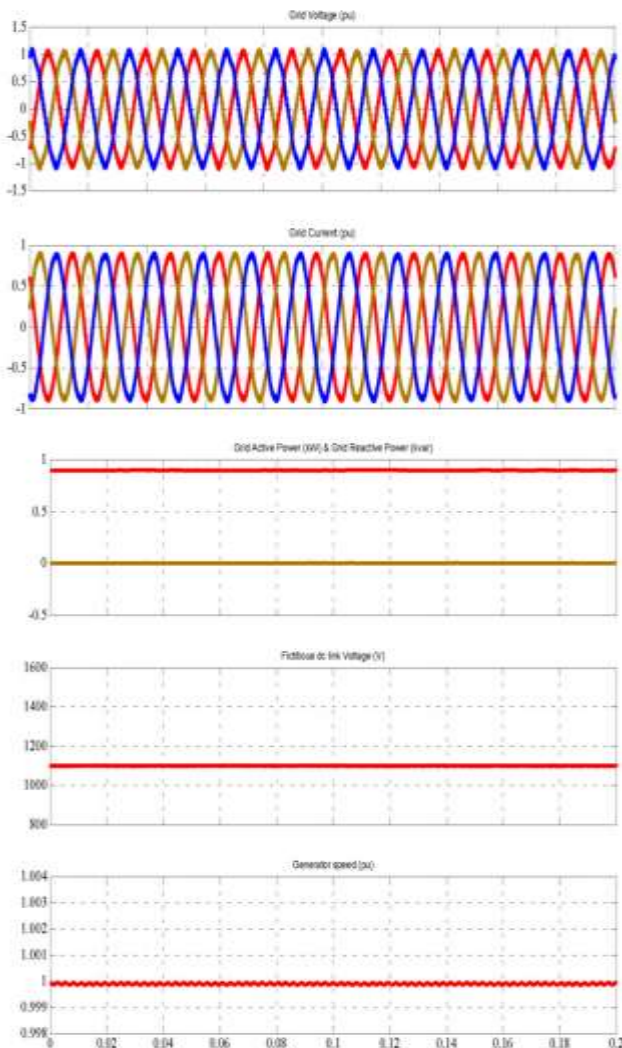



Figure 8: Replicated replies during steady-state state. Grid voltage (pu), grid current (pu), grid active power (kW), grid reactive power (kvar), fictitious dc link voltage (V), generator speed (pu).

3.2 Response under Varying Wind Speed Condition


The system is affected by the renewable energy integration. As per various grid codes, renewable energy plants must be able to ride through disturbances without disconnection. Voltage sag trip settings would allow the equipment to ride through during voltage sag as per IEEE Standard 1547a and this allows a plant not to trip if the duration of voltage sags is between default settings and maximum up to 12 m/s as given.

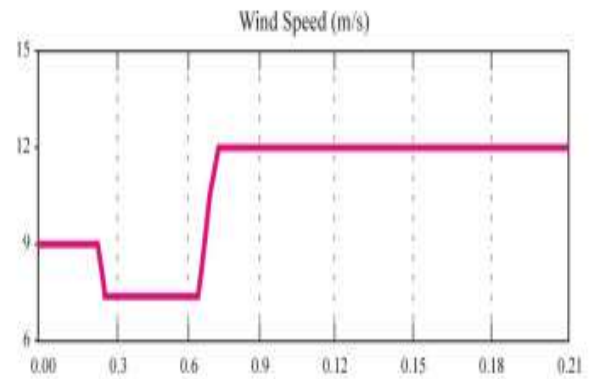

(a) Wind velocity

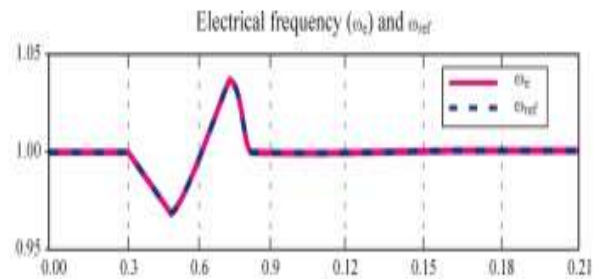

(b) Electrical frequency and its reference

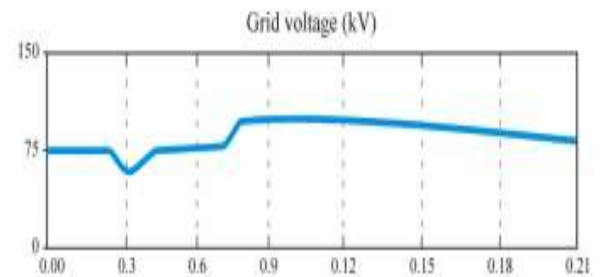

(c) RMS grid voltage

Figure 9: Replicated replies during modification in wind speed. (a) wind speed, (b) Electrical frequency and its reference, and (c) RMS grid voltage

3.3 Response under varying load conditions

As far as markets and manufacturers are concerned worldwide, China became the largest markets with over 13.1 GW capacity installed in 2012, together with China (13 GW) and the EU (11.9 GW) sharing around 87% of the global market.

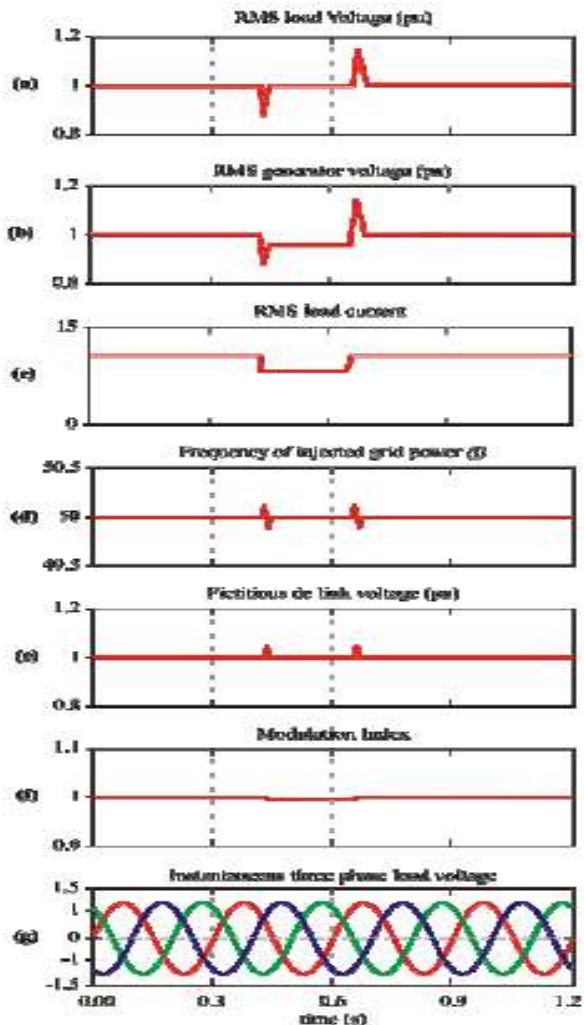


Figure 10: Response with proposed control

The development of wind power in India began in the 1990s by Tamil Nadu Electric Board near Tuticorin, and has significantly increased in the last decade. As of 31st March 2016, the installed capacity of wind power was 26.74 GW, spread across many states of India.

3.4 Response under Fixed -State Form

The steady-state capacity of various energy sources in India, as of 30th June, 2017 and total renewable energy installed capacity as of 30th June, 2017 (SourceMNRE). Therefore, wind power grows more significant than any other renewable for wind generation systems.

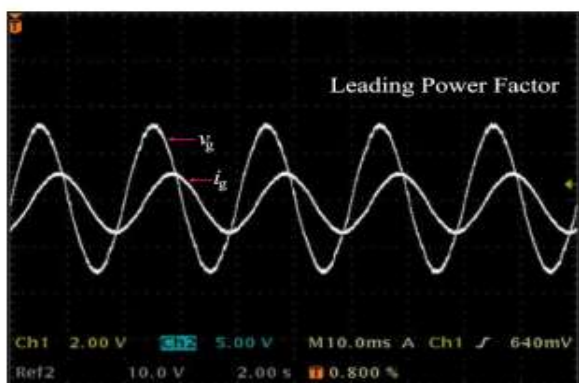
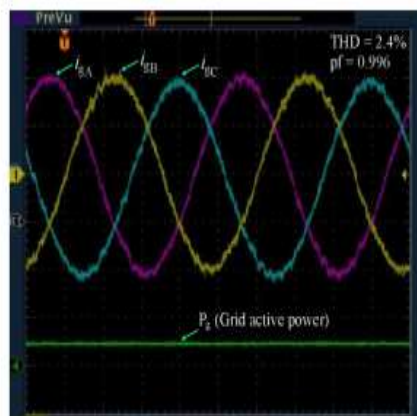


Figure 11: Leading pf operation

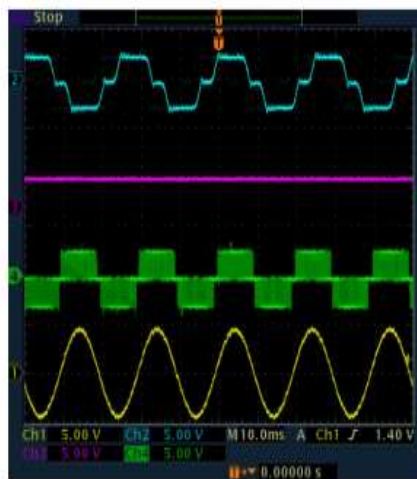


Figure 12: Lagging pf operation

The growth of electricity generation in India has been hindered by domestic coal shortages and as a consequence, India's coal imports for electricity generation increased by 18% in 2010:



(a) Injected grid current and injected grid active power



(b) Ch1: grid phase voltage; ch2: phase voltage of generator; ch:3 fictitious dc link voltage of IMC; ch4: IMC output phase voltage

Figure 13: Experimental waveform during steady-state condition

3.5 Dynamic Response During Change In Current Command Of Indirect Matrix Converter

The results of this study are helpful to the policy makers to frame suitable entrepreneurship development strategies to

develop entrepreneurs and to prevent business failure 21.45A, correspondingly.

industrial units, contributing 40 per current (ig), injected grid active power (Pg), grid voltage (vg), frequency of injected grid power (f), and power factor.

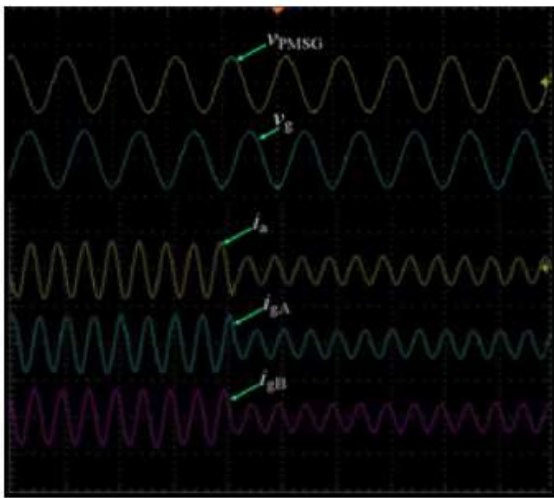
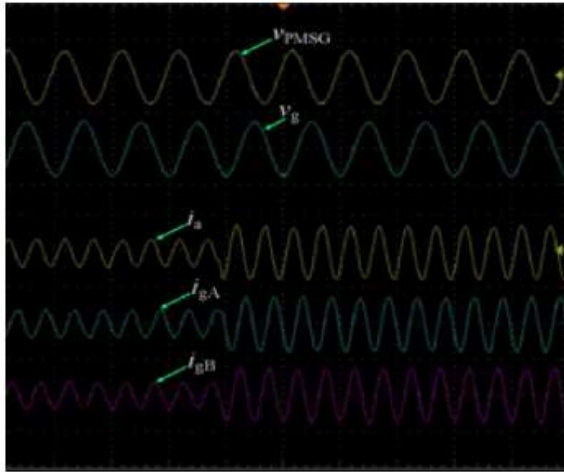


Figure 14: Experimental waveforms when current command for IMC is suddenly changed

3.6 Dynamic Response During Change In Input Voltage Of Indirect Matrix Converter

It can be seen that closed loop control is able to maintain the fictitious dc link voltage magnitude stable. When input voltage is suddenly drooping, the amplitude of grid voltages is steady, whereas grid current decreases as expected with the proposed controller.


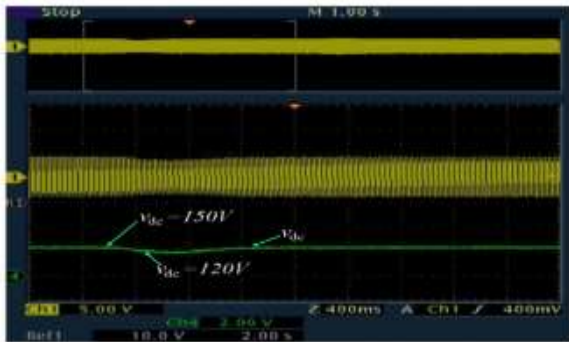



Figure 15: Grid voltage; and fictitious dc link voltage of IMC

3.7 Response Under Varying Wind Speeds


The output, exports and fostering entrepreneurship. Currently, the sector accounts for about 95 per cent of the

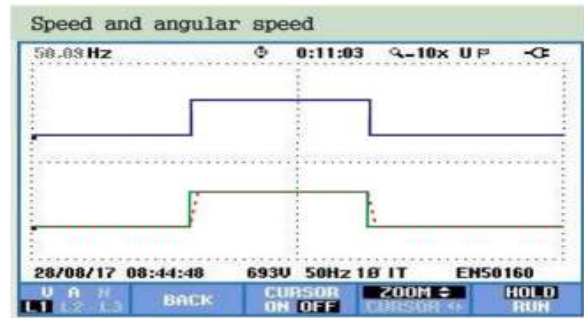

(a) Wind speed and angular speed of generator

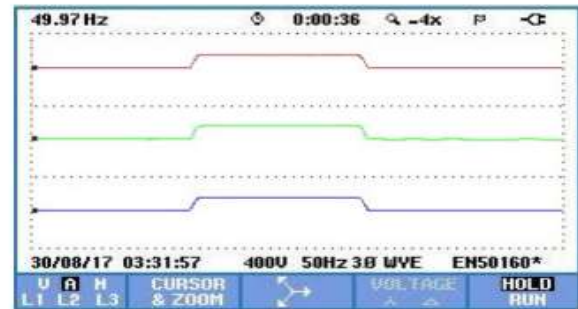

(b) Injected grid current

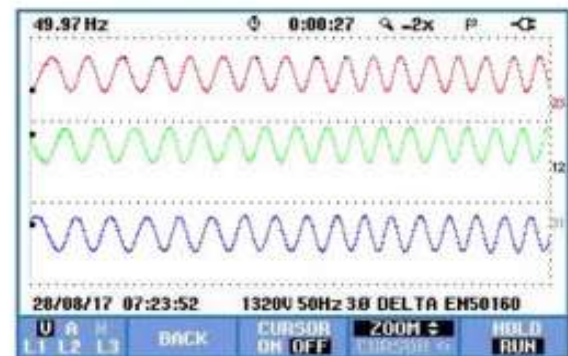

(c) Grid voltages



(d) Injected grid active power

Figure 16: Experimental waveform during varying wind conditions. (a) wind speed (v); generator angular speed (w); and reference angular speed (wref), (b) injected grid currents (igA, igB, igC); (c) grid phase voltages (vgA, vgB, vgC); (d) grid active power (Pg)

IV. CONCLUSION

Adaptive fuzzy logic control strategy has been developed for indirect matrix converter based wind generation system for achieving the maximum energy yield with reduced harmonics. Indirect matrix converter which finds its suitable application for generation system is used to interface the PMSG with the grid through business web portals. These technology strategies can up SEO of business. It can be said that after adopting better culture of technological enhancement e.g., Big Data, IoT, Semantic Web, one can enhance one's business with better economic changes. In this paper I have come across at various strategies required for winning e-business and developed to adjust the turbine shaft speed and accordingly, control the active power injected into the grid to track maximum power for all wind speeds.

REFERENCES

- [1] R. C. Portillo , M. M. Prats and J. I. Leon "Modelling strategy for back-to-back three-level converters applied to high-power wind turbines", *IEEE Transaction Ind. Electron.*, vol. 53, no. 5, pp.1483-1491 2006
- [2] R. Pena, J.C. Clare, and G.M. Asher, "A doubly fed induction generator using back-to-back PWM converters supplying an isolated load from a variable speed wind turbine", *IEE Proc. - Electric Power Applications*, vol. 143, no. 5, Sep. 1996 pp.:380 – 387. INTERNATIONAL JOURNAL of RENEWABLE ENERGY RESEARCH Vinod Kumar et al. ,Vol.4, No. 1, 2014 22
- [3] P. Rodriguez, A.V.Timbus, R.Teodorescu, M.Liserre and F. Blaabjerg "Flexible active power control of distributed power generation systems during grid faults", *IEEE Transaction Ind. Electron.*, vol. 54, no. 5, pp. 2583 - 2592, 2007.
- [4] R. Teodorescu and F. Blaabjerg, "Flexible control of small wind turbines with grid failure detection operating in stand-alone and grid-connected mode", *IEEE Transaction Power Electronics*, vol. 19, no. 5, Sep. 2004, pp. 1323, 1332.
- [5] S. Muller , M. Deicke and R. W. De Doncker "Doubly fed induction generator systems for wind turbine", *IEEE Ind. Appl. Mag.*, vol. 8, no. 3, pp.26 -33 2002
- [6] A. Garc s, M. Molinas, A Study of efficiency in a Reduced Matrix Converter for Offshore Wind Farms", *IEEE Transactions on Industrial Electronics*, vol. 59, no. 1, pp. 184 – 193, Jan. 2012.
- [7] R. Cardenas, R. Pena, P. Wheeler, J. Clare, and G. Asher, "Control of the reactive power supplied by a WECS based on an induction generator fed by a matrix converter," *I Transaction Ind. Electron.*, vol. 56, no. 2, pp. 429–438, Feb. 2009.
- [8] H. Nikkhajoei and M. Iravani, "A matrix converter based micro-turbine distributed generation system," *I Transaction Power Del.*, vol. 20, no. 3, pp. 2182– 2192, Jul. 2005.
- [9] R. Cárdenas, R. Pen,a, J. Clare, and P. Wheeler, "Analytical and experimental evaluation of a W CS based on a cage induction generator fed by a matrix converter," *I Transaction Energy Convers.*, vol. 26, no. 1, pp. 204–215, Mar. 2011.
- [10] V. Kumar, R. R. Joshi, and R. C. Bansal, "Optimal control of matrix-converter-based WECS for performance enhancement and efficiency optimization," *IEEE Transaction Energy Conversion*, vol. 24, no. 1, pp.264–273, Mar. 2009
- [11] S. M. Barakati, M. Kazerani, and J. D. Aplevich, "Maximum power tracking control for a wind turbine system including a matrix converter," *I Transaction Energy Conversion*, vol.24,no.3,pp.705-713, Sep.2009.
- [12] Fang Gao, and M. Reza Iravani, "Dynamic model of a space vector modulated matrix converter", *IEEE Transaction Power Delivery*, vol. 22, no. 3, Jul.2007, pp. 1696-1705.
- [13] M. Chinchilla, S. Arnaltes, and Burgos, "Control of permanent-magnet generators applied to variable-speed wind-energy systems connected to the grid", *IEEE Transaction of Energy Conversion*, vol. 21, no.1, Mar. 2006, pp. 130-135.
- [14] K. H. Kim, Y. C. Jeung, D. C. Lee, and H. G. Kim, "LVRT scheme of PMSG wind power systems based on feed-back linearization," *I Transaction Power Electron.*, vol. 27,no.5, pp.2376–2384, May 2012.
- [15] J. G. Sloopweg, S. W. H. de Haan, H. Polinder, and W. L. Kling, "General model for representing variable speed wind turbines in power system dynamics simulations", *IEEE Transaction Power Systems*, vol. 18, no. 1, Feb.2003, pp. 144-151